



Control box 1

* When using more than one control box
* Provide bridge in the last one only.

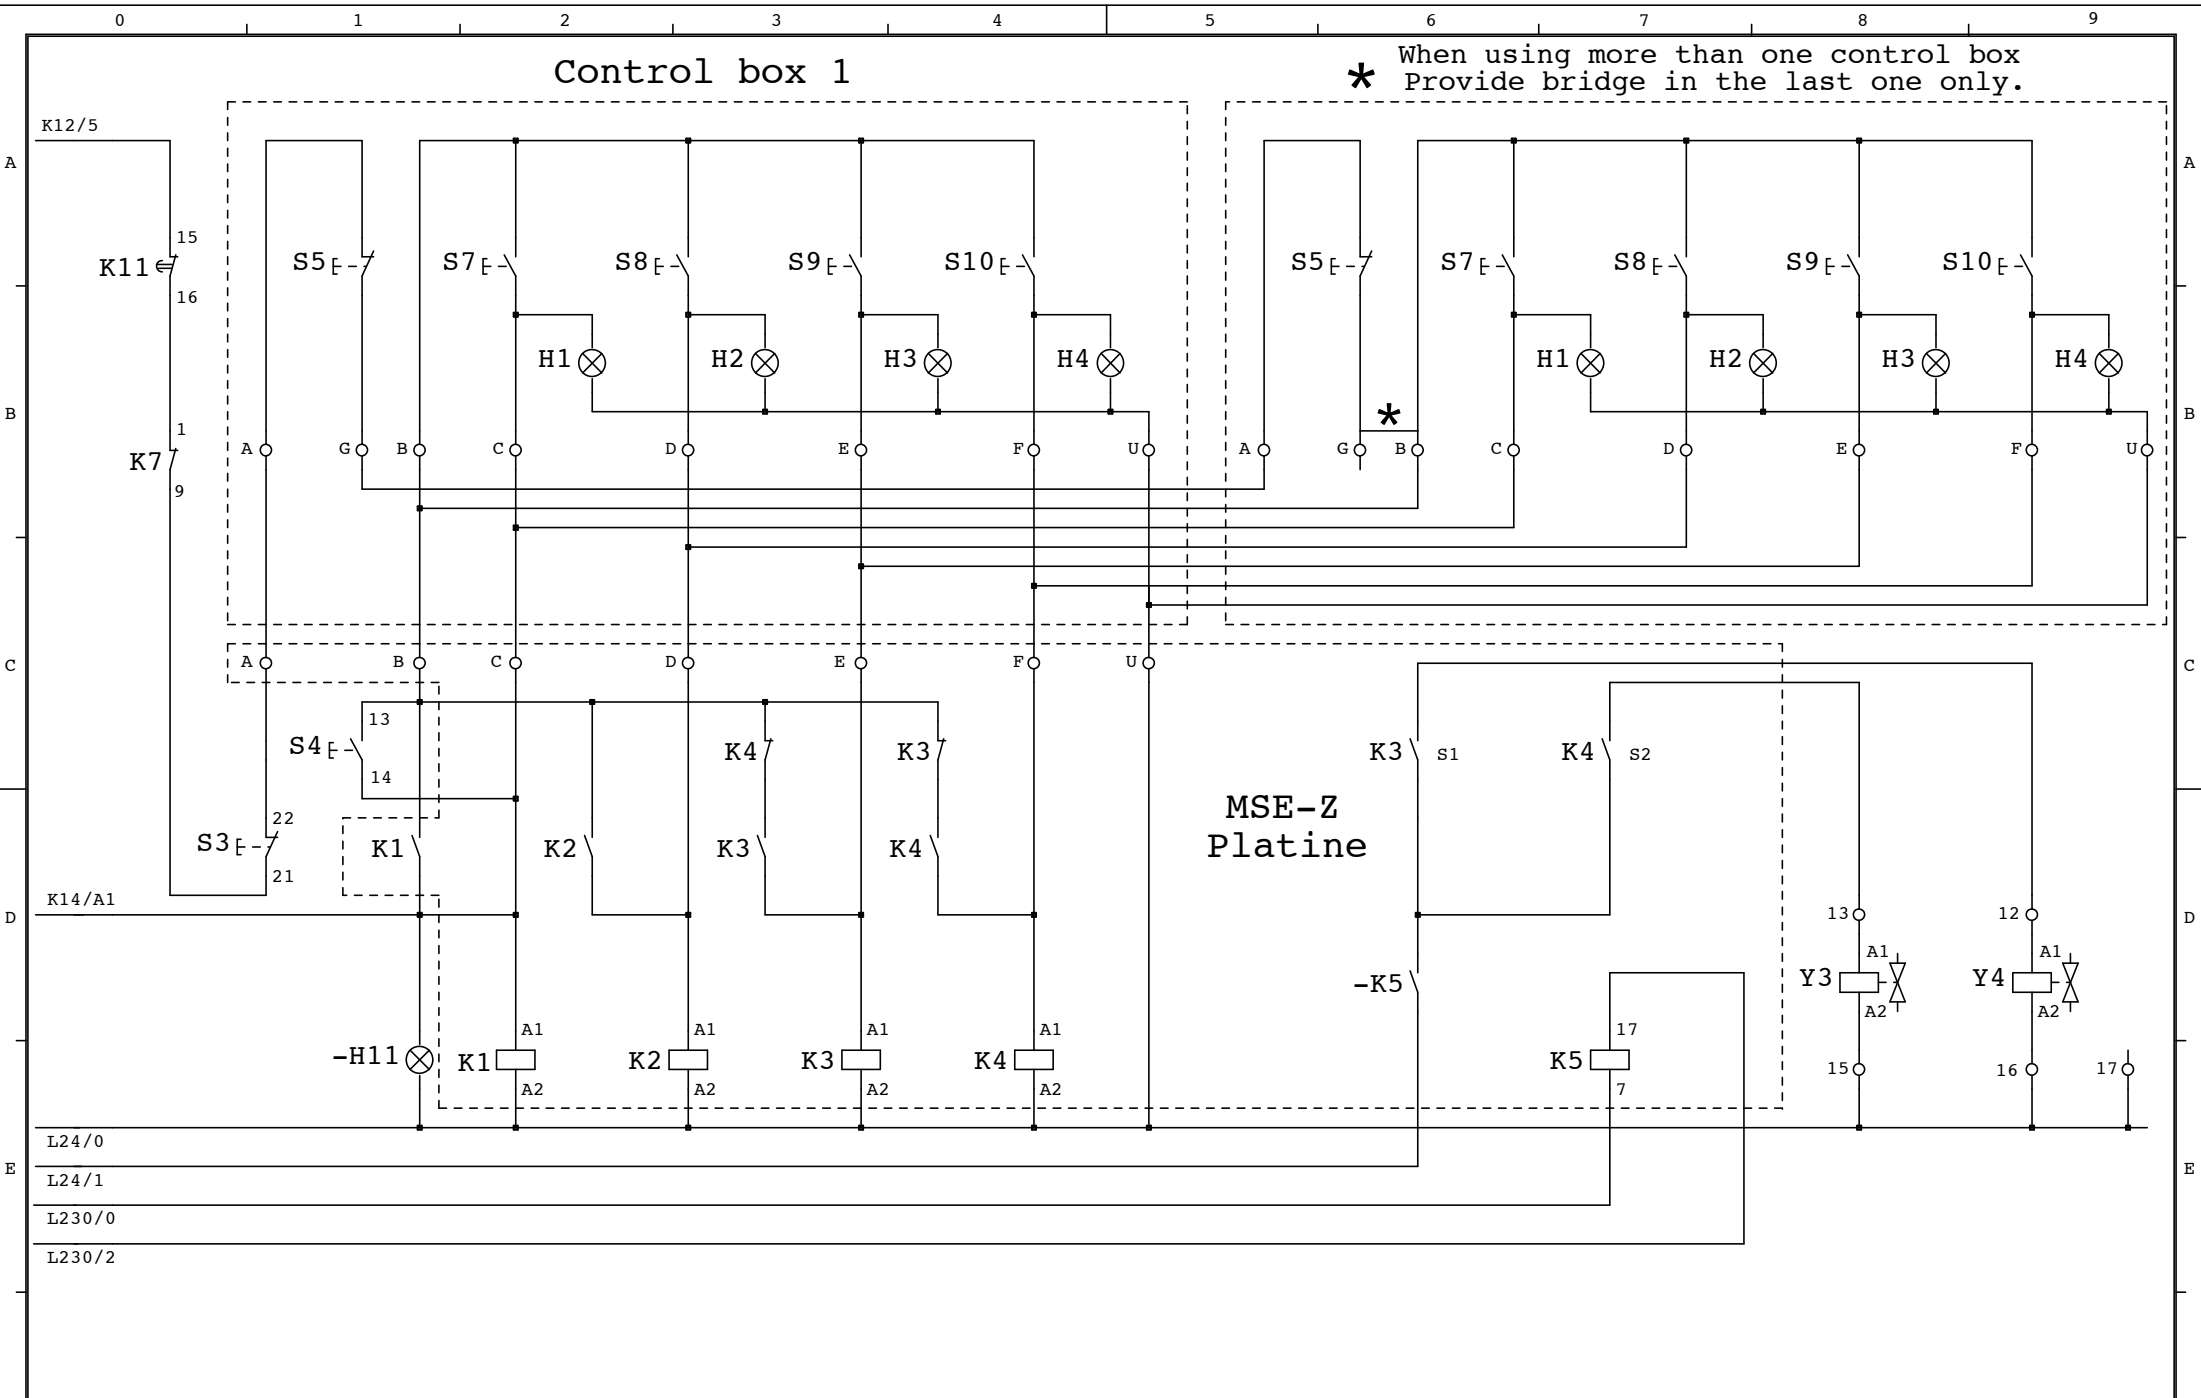

				Datum	05.09.2012	FRANK GmbH			FCM MSE-Z				
				Bearb.		Zur Dornheck 15 - 17				www.frank-hdr.de	400V 50Hz		
				Gepr.		D - 35764 Sinn - Fleisbach							
Zust.	Änderung	Datum	Name	Norm	Urspr.	Ers. f.	Ers. d.			von	3Bl.		
0								1	2	3	4		



Supply cable

Motor - pump

Pressure switch START

Pressure switch STOP

temperature control

solenoid valve pressure relief

solenoid valve detergent A

solenoid valve detergent B

SME Control box

solenoid valve frost protection

Optional

				Datum	05.09.2012	FRANK GmbH			FCM MSE-Z	Terminal diagram				
				Bearb.		Zur Dornheck 15 - 17					www.frank-hdr.de	400V 50Hz		
				Gepr.		D - 35764 Sinn - Fleisbach								
Zust.	Änderung	Datum	Name	Norm		Urspr.	Ers. f.	Ers. d.			Blatt 3			
0					1				2		von 3Bl.			
					2				3					
					3				4					
					4				5					
					5				6					
					6				7					
					7				8					
					8				9					
					9									